

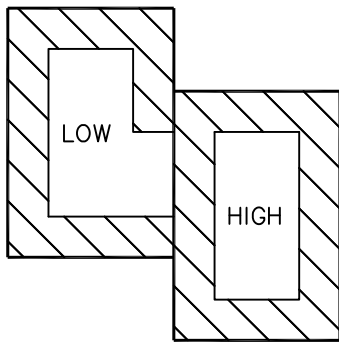


MINIMUM OF ONE 4' (1200mm),
5' (1500mm), OR 6' (1800mm)
WIDE PERIMETER SHEET
(NOTES 1 & 2)

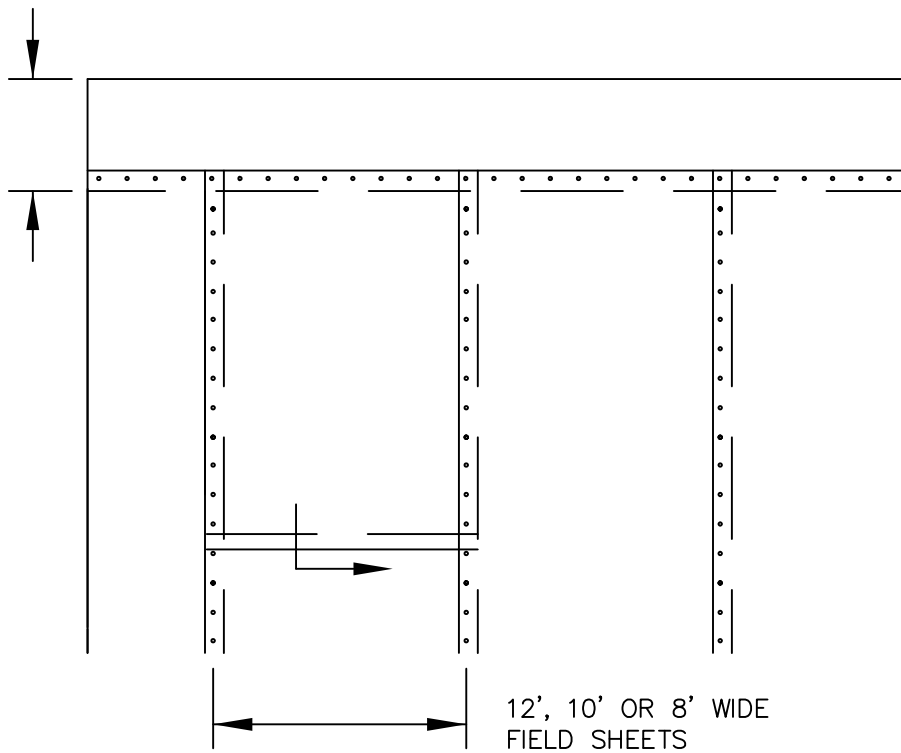

 PERIMETER
AREA

ROOF HEIGHT
DIFFERENTIAL
GREATER THAN 3'

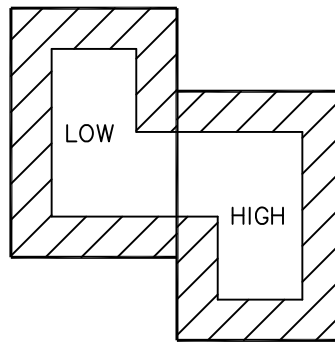

 PERIMETER
AREA

ROOF HEIGHT
DIFFERENTIAL
LESS THAN 3'

NOTES:

1. WHEN USING 10' (3000 mm) or 12' (3700 mm) WIDE FIELD SHEETS, 5' (1500mm) or 6' (1800 mm) WIDE PERIMETER SHEETS ARE UTILIZED. WHEN USING 8' (2400 mm) WIDE FIELD SHEETS, 4' (1200 mm) WIDE PERIMETER SHEETS ARE USED.
2. REFER TO MANUFACTURES APPROVALS FOR MEMBRANE FASTENING CRITERIA FOR REQUIRED NUMBER OF PERIMETER SHEETS AND MEMBRANE FASTENING.
3. SECUREMENT NOT REQUIRED AT END ROLL SECTIONS; OVERLAP MEMBRANE 2" TO 3" (50 mm TO 75 mm).
4. FOR INSULATION SECUREMENT, REFER TO FLEX MF/R 1.
5. IF A FACTORY MUTUAL RATING IS REQUIRED, MEMBRANE FASTENING AT CORNERS MUST EXTEND TO ROOF EDGES IN BOTH DIRECTIONS.

TITLE	
TPO MEMBRANE SHEET LAYOUT	
NAME	
DETAIL NO. 2.10	
DRAWN BY:	DATE:
SK	8/2012
APPLICABLE TO ALL FLEX TPO	
MECHANICALLY FASTENED SYSTEMS	
FLEX MEMBRANE INTERNATIONAL	2670 LEISCZS BRIDGE RD LEESPORT, PA 19533 800-969-0108 FlexRoofingSystems.com